


APPENDIX B


- KEY**
- Premises boundary - INTERIOR
 - Escape route
 - Security camera (indicative position)
 - FE sign Fire exit sign
 - PB Emergency push bar
 - S Smoke detector
 - CO Fire extinguisher - Carbon Dioxide
 - V Fire extinguisher - Water
 - Non-maintained emergency lighting. (BS 5266)
 - Maintained emergency lighting. (BS 5266)
 - SS Smoke sounder
 - CF Call point

Fire risk assessment to be carried out by client.
 Fire alarm system is installed which conforms to BS 5839 part 6.

- SALES FLOOR
119.65 sq m (1288 sq ft)
- ALCOHOL DISPLAY - shown in grey areas
4.46 sq m (48.08 sq ft)
- ALCOHOL STORAGE AREA
11.33 sq m (122 sq ft)

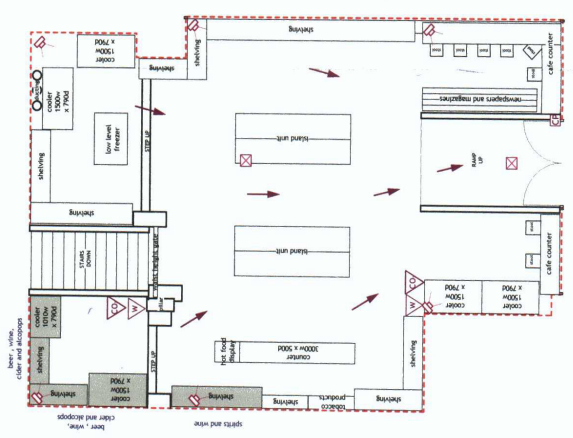

Ground floor layout

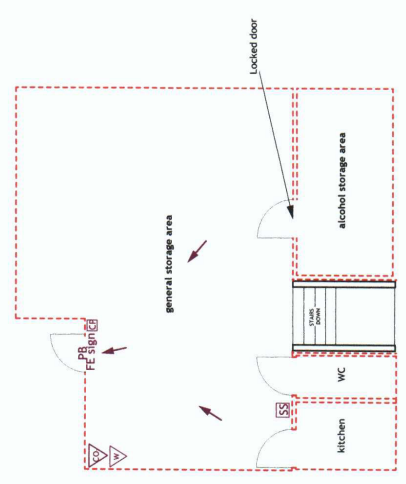

Lower ground floor layout

04-08-09 scale 1:100 @ A3
 93 North Road, Brighton

